


**CURB HEAT TAPE
208 VOLT, 1 PHASE
PANEL "XX", CIRCUIT ##**

NOTE:
USE PVC CONDUIT & BOXES
LOCATED WITHIN REFRIGERATED SPACES

USE RIGID STEEL CONDUIT & BOXES
BELOW 10'-0" AFF ON OUTSIDE OF
REFRIGERATED SPACES

ELECTRICAL RISER AT WALL

NOTE:
1. HEATING CABLE ON OUTSIDE OF FROZEN FOOD STORAGE, CABLE BY RAYCHEM, ELECTROMELT INSULATED CABLE, CAPACITY 12 - 14 WATTS/12" 08V, 1 PHASE, PROVIDE ON ALL EXTERIOR CURB AROUND FROZEN FOOD.

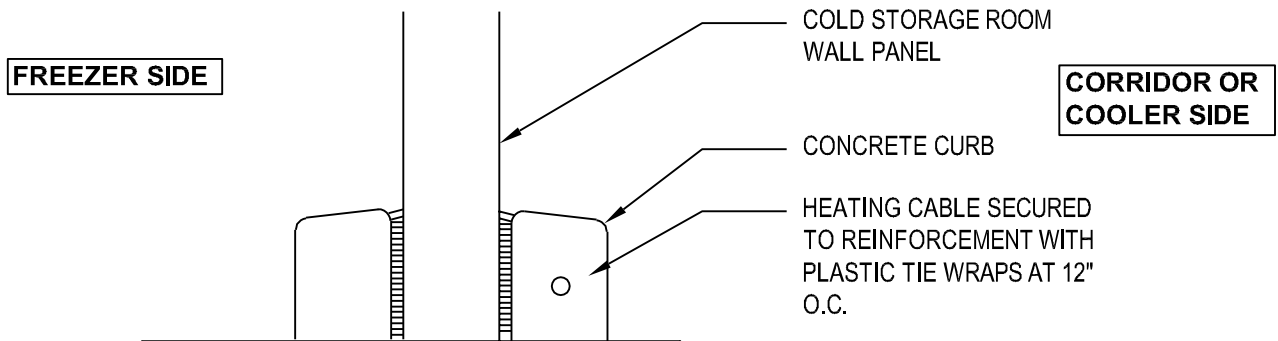

SECTION

DATE	DEFENSE COMMISSARY AGENCY DIRECTORATE OF ENGINEERING FORT LEE, VIRGINIA - LACKLAND AFB, TEXAS		DESIGN STANDARD
JUN 2022	TITLE	REF.	132126-08
	ELECTRICAL FOR CURB HEATER CABLE	REV.	