


## SUB HUB COMMUNICATION ROOM #31 FLOOR PLAN

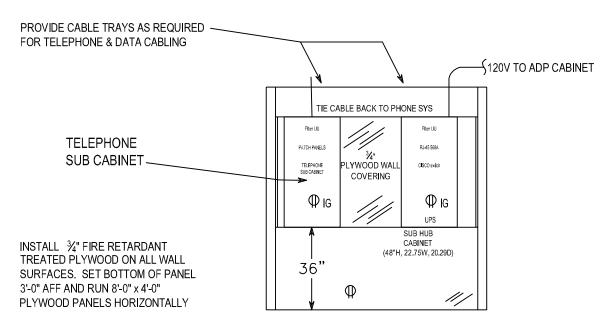

## ELEVATION A-A

## NOTE:

- 1. SUB HUB ROOM REQUIRED FOR MEDIUM TO LARGE STORES WHERE CABLING REQUIREMENT EXCEEDS 300' FROM MAIN CISIC CABINET TO CONNECTING DEVICE.
- 2. CONNECTION TO EMERGENCY GENERATOR POWER REQUIRED.
- 3. INTERIOR LIGHT REQUIRED.

DATE	DEFENSE COMMISSARY AGENCY DIRECTORATE OF ENGINEERING FORT LEE, VIRGINIA - LACKLAND AFB, TEXAS		DESIGN STANDARD
JUN 2022	SUB-HUB ROOM FLOOR PLAN	REF.	271500-08